


SPEEDWIRE

SYSTEMS™

2 Stage Nitrous Controller with Main Board and Auxiliary Module

This schematic example is showing a Speedwire Systems 2 Stage Nitrous Controller connected to a Speedwire Systems Main Controller with a Speedwire Systems Auxiliary Module used to control a fuel pump. Note: individual setups may vary, use this illustration as a guide.

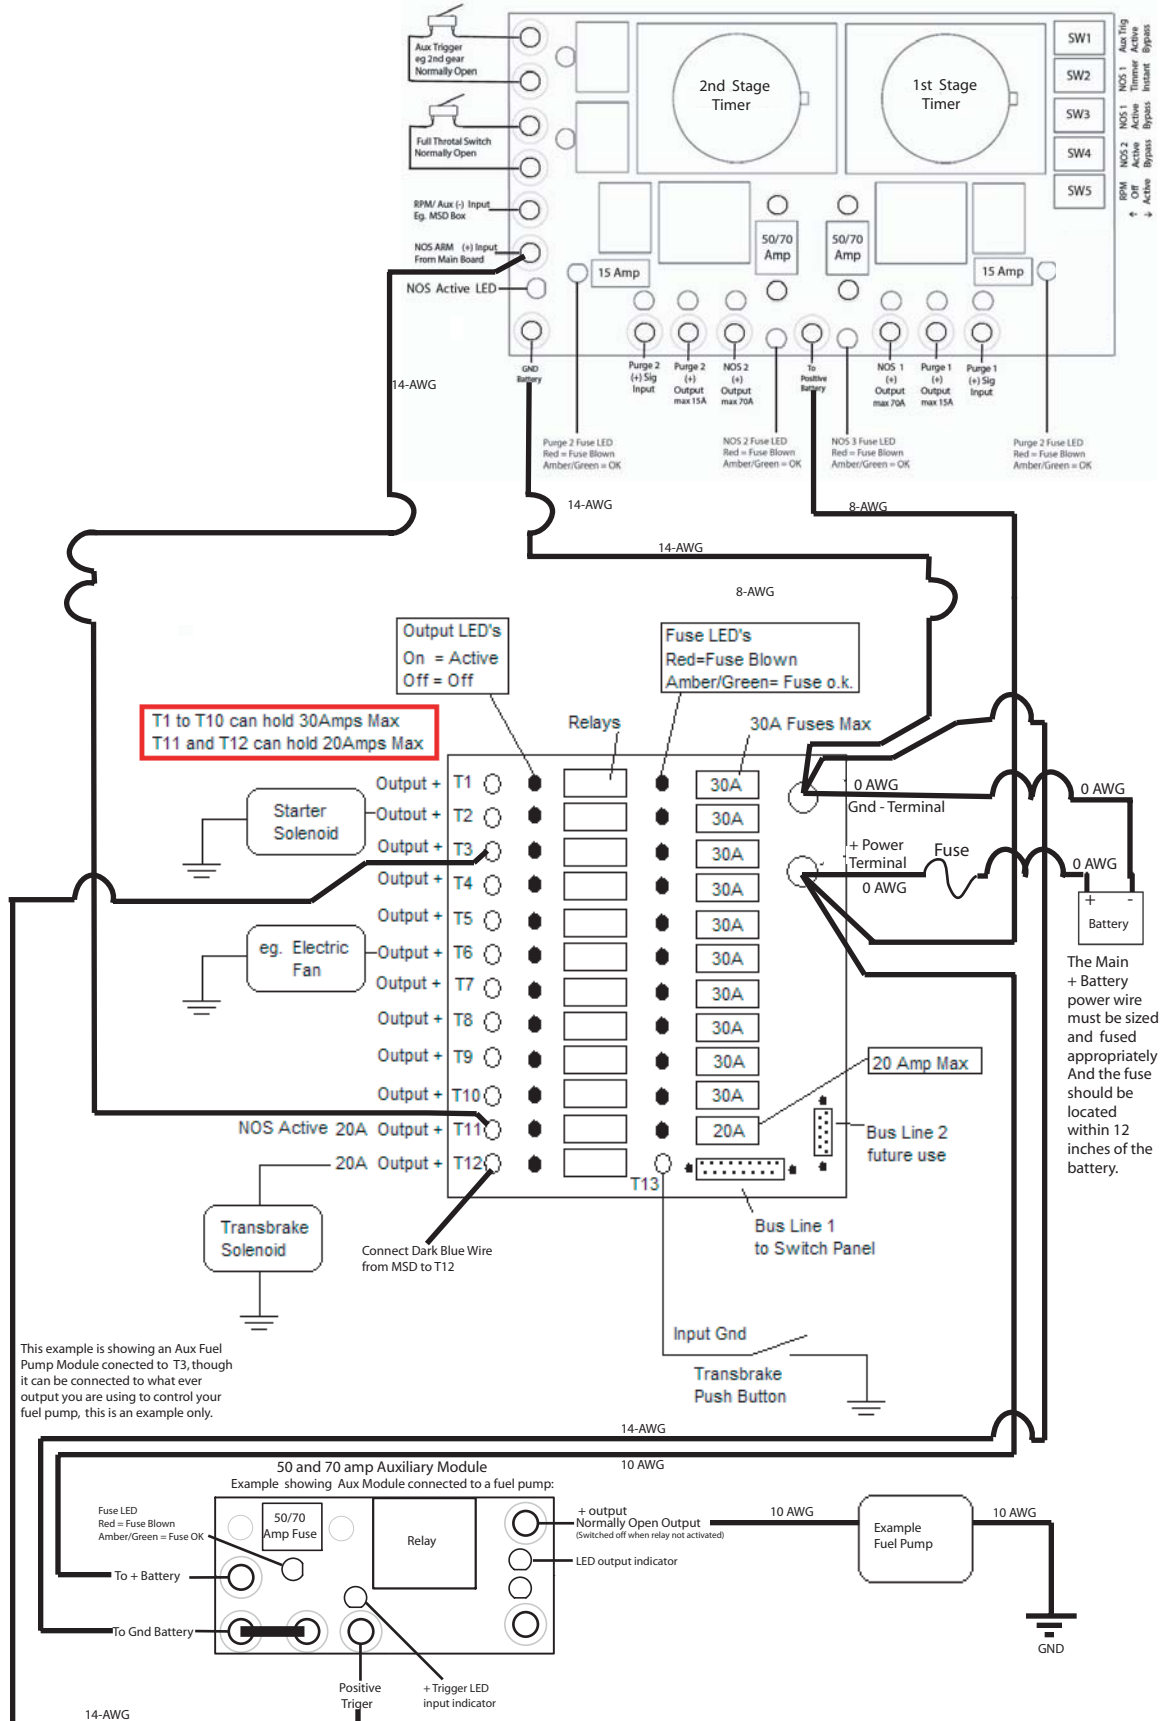

Additional notes:
Each nitrous + output from the NOS controller will connect with 10AWG wire to there appropriate nitrous solenoids.

MSD ignition retards can get signals from each stage output; connect the MSD retard wires to the appropriate nitrous outputs on the NOS controller. For example the MSD pink wire can connect to the 1st stage output terminal and the MSD violet wire to the 2nd. These are just examples; you will have to connect according to your conditions and ignition controller specs.

Note: All electrical connections must be correct ie. (+ to +) (- to -). Power or Battery connections CAN NOT be wired in reverse or crossed in any way. Warranty will be void if not installed correctly.

Note:
There must be an adequate safety fuse cutoff device directly after the battery between the battery bank and any other devices.

Use appropriate sized wire conductors, as per application. See wire AWG size chart, consult the American Wire Gauge recommendations.

This example is showing an Aux Fuel Pump Module connected to T3, though it can be connected to what ever output you are using to control your fuel pump, this is an example only.

The Main + Battery power wire must be sized and fused appropriately. And the fuse should be located within 12 inches of the battery.